

AR 31-2

Datum jjjj-mm-dd

bindendverklaring

Approval requirement 31-2

Sealing materials for metallic threaded joints.
Part 2: Non-hardening jointing compounds



Trust
Quality
Progress

Foreword

This GASTEC QA Approval requirement has been approved by the Board of Experts product certification GASTEC QA, in which relevant parties in the field of gas related products are represented. This Board of Experts supervises the certification activities and where necessary require the GASTEC QA Approval requirement to be revised. All references to Board of Experts in this GASTEC QA Approval requirement pertain to the above mentioned Board of Experts.

This GASTEC QA Approval requirement will be used by Kiwa Nederland BV in conjunction with the GASTEC QA general requirements and the KIWA regulations for product certification. This regulation details the method employed by Kiwa during product certification.

Approved by Board of Experts : xxx

Accepted by Kiwa Nederland B.V. : xxx

CONCEPT

Kiwa Nederland B.V.

Wilmersdorf 50
Postbus 137
7300 AC Apeldoorn

Tel. 088 998 33 93
Fax 088 998 34 94
info@kiwa.nl
www.kiwa.nl

© 2017 Kiwa N.V.

All rights reserved. No part of this book may be reproduced, stored in a database or retrieval system, or published, in any form or in any way, electronically, mechanically, by print, photoprint, microfilm or any other means without prior written permission from the publisher.

The use of this evaluation guideline by third parties, for any purpose whatsoever, is only allowed after a written agreement is made with Kiwa to this end

Contents

1	Introduction	3
1.1	General	3
1.2	Scope	3
2	Definitions	4
3	Product requirements	5
3.1	General	5
3.2	Classification of jointing compounds	5
4	Performance requirements	6
4.1	General	6
4.2	Leak tightness	6
4.3	Leak tightness after adjustment	6
4.4	Resistance to a pressure blast	6
4.5	Resistance to high temperatures	6
5	Marking and instructions	8
5.1	Marking	8
5.2	Instructions	8
6	Quality system requirements	9
7	Summary of tests	10
7.1	Test matrix	10
8	List of referenced documents	11
8.1	Standards / normative documents	11

1 Introduction

1.1 General

This GASTEC QA approval requirement in combination with the GASTEC QA general requirements include all relevant requirements, which are adhered by Kiwa as the basis for the issue and maintenance of a GASTEC QA certificate for Sealing materials for metallic threaded joints, Part 2: non-hardening jointing compounds,.

This GASTEC QA Approval requirements replace the GASTEC QA Approval Requirements 31-2 Sealing materials for metallic threaded joints in contact with 1st, 2nd and 3rd family gases and hot water – Part 2: Non-hardening jointing compounds, dated March 2012.

List of changes:

- Requirements resistance to high temperatures added
- Update to the new format for GASTEC QA approval requirements
- These approval requirements have been fully reviewed textually.
- All general requirements have been deleted and included in the GASTEC QA general requirements document
- Change of paragraphs
- Update of list of referenced documents

1.2 Scope

These approval requirements apply to non-hardening jointing compounds for metallic threaded joints according to EN 10226-1. The sealing materials are suitable for use in gas installations for 2nd family gases (natural gas) and 3rd family gases (liquefied petroleum gas- LPG) according to NEN-EN 437 and for hot water heating systems.

2 Definitions

In this approval requirement, the following terms and definitions are applicable:

Board of Experts: The Board of Experts Gastec QA.

CONCEPT

3 Product requirements

3.1 General

The product shall comply with the requirements described in NEN-EN 751-2.

Supplementary to that stated in NEN-EN 751-2 the product shall comply with the following product requirements.

3.2 Classification of jointing compounds

In contrast to EN 751-2 article 4 following classification shall be used.

“Klasse 0,2” materials shall meet the requirements for Class B of NEN-EN 751-2.

“Klasse 8” materials shall meet the requirements for Class AR₁ of NEN- EN 751-2.

“Klasse 20” materials shall meet the requirements for Class C of NEN-EN 751-2.

CONCEPT

4 Performance requirements

4.1 General

The product shall comply with the requirements described in NEN-EN 751-2.

Supplementary to that stated in NEN-EN 751-2 the product shall comply with the following performance requirements (chapter 4.2 and 4.3).

4.2 Leak tightness

In contrast to article 7.2.1.2 of NEN-EN 751-2 the test pressures shall be according to table 1.

Test method

The test samples shall be tested during 15 minutes at a test pressure according to table 1. During the last 5 minutes the sample is visually inspected for leakage.

Class	Test pressure in bar during 15 ± 1 min.
Klasse 0,2 bar	$0,3 \pm 0,015$
Klasse 8 bar	$12 \pm 0,3$
Klasse 20 bar	$30 \pm 1,5$

Table 1

4.3 Leak tightness after adjustment

All classes of non-hardening jointing compounds shall be tested for "limited turn back" properties according to chapter article 7.2.1.3 of NEN-EN 751-2. Leak tightness shall be determined according to chapter 4.2 of this approval requirement.

4.4 Resistance to a pressure blast

The test assemblies in accordance to EN 751-2, clause 7.2, shall be leak tight after subjected to a pressure blast.

Test method

The test assemblies shall be subjected to a pressure blast in accordance with table 2. After being subjected to the pressure blast the test assemblies are tested according to chapter 4.2 of this of these approval requirement.

Class	Pressure blast in bar during $10 -0/+5$ sec.
Klasse 0,2 bar	$1 \pm 0,01$
Klasse 8 bar	$16 \pm 0,5$
Klasse 20 bar	N.A.

Table 2

4.5 Resistance to high temperatures

The steel pipes (including protection/isolation) shall be resistant to a radiation heat of 10 kW/m^2 during 30 minutes. The leakage shall be $\leq 5 \text{ l/h}$ after testing.

Test method

The test shall be performed at a temperature of $20\text{ }^{\circ}\text{C} \pm 5\text{ }^{\circ}\text{C}$. The test samples shall be conditioned at least 24h before testing at a temperature of $20\text{ }^{\circ}\text{C} \pm 5\text{ }^{\circ}\text{C}$ and a humidity of $60\% \pm 20\%$.

The test is performed in a horizontally test equipment as shown in figure 1. The leakage shall be measured in accordance to Annex A of EN 1775:2007.

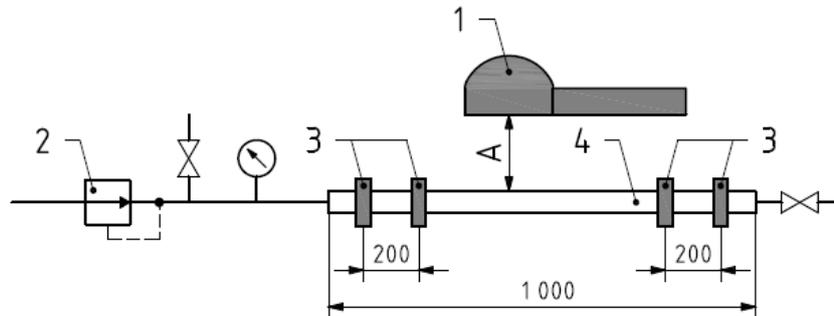


Figure 1

Legend:

- 1 heat cup
- 2 measuring system as described in appendix A of NEN-EN-1775:2007
- 3 mounting brackets
- 4 to be tested sample
- A distance between heat cup and surface of the assembled component (for example the outside of a casing)

The test sample shall be mounted in the test equipment without stress or tension on the test sample, see figure 1.

Before the start of the high temperature test, the sample is tested on leakage at 200 mbar during 5 minutes. Record the leakage value (l/h)

Expose the test sample during 30 minutes to a heat radiation of 10 kW/m^2 . The distance between the heating cup and the sample shall be calculated with the data on the calibration file of the heating cup.

Determine the leakage after the high temperature test during 5 minutes at 200 mbar. Record the value (l/h).

5 Marking and instructions


5.1 Marking

In addition to that stated in NEN-EN 751-2, chapter 8, each package of jointing compound shall be marked to with the following information:

- The GASTEC QA word mark or logo.
- Pressure class “Klasse 0,2”, “Klasse 8” or “Klasse 20” as mentioned in table 1.
- A note that the non-hardening jointing compounds can be used on metallic pipe joints only. In Dutch: “Alleen voor metalen pijpschroefdraadverbindingen”.

5.2 Instructions

In addition to that stated in NEN-EN 751-2, chapter 8 the instructions shall be supplied in the Dutch language.

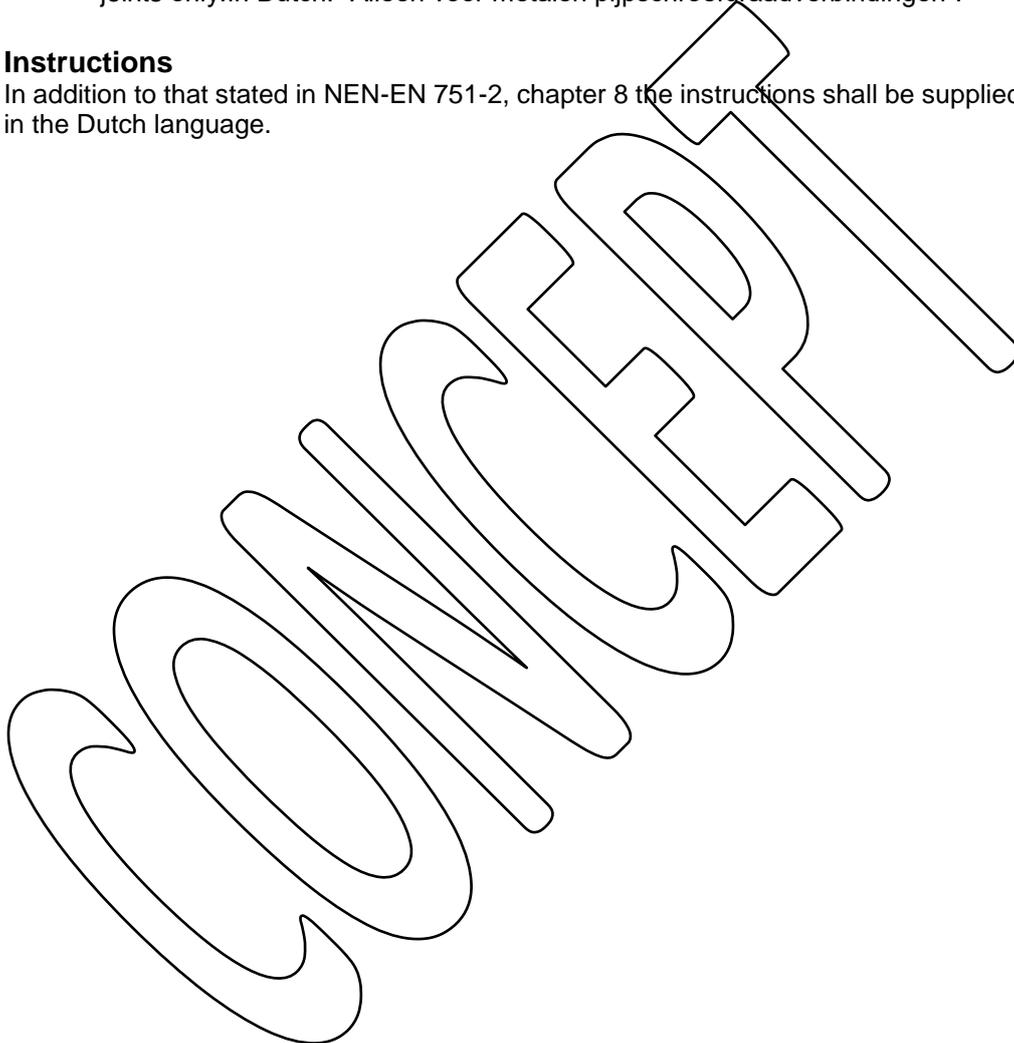

6 Quality system requirements

The supplier shall make a risk assessment of the product and production process according to chapter 3.1.1.1 and 3.1.2.1 of the GASTEC QA general requirements. The risk assessments shall be available to Kiwa for review.

CONCEPT

7 Summary of tests

This chapter contains a summary of tests to be carried out during:

- The initial product assessment;
- The periodic product verification;

7.1 Test matrix

Description of requirement	Clause NEN-EN 751-2	Test within the scope of		
		Initial product assessment	Product verification Verification	Frequency
Requirements to be met by the jointing compound as received	5.1			
General	5.1.1	X	X	Once a year
Corrosive properties	5.1.2	X		
Storage properties	5.1.3	X		
Requirements to be met by the jointing compound after assembly	5.2			
Sealing properties	5.2.1	X		
Soundness	5.2.1.1	X		
Resistance to gas condensates	5.2.1.3	X	X	Once a year
Resistance to hot water	5.2.1.4	X		
Resistance to temperature cycling	5.2.1.5	X	X	Once a year
Resistance to vibration	5.2.1.6	X		
Compatibility with foam forming leak testers	5.2.2	X		
Hardening and dismantling	5.2.3	X		
Re-test	5.3	X		
Additional GASTEC QA approval requirements (KE 31-2)				
Classification of jointing compounds	3.2	X		
Leak tightness	4.2	X	X	Once a year
Leak tightness after adjustment	4.3	X	X	Once a year
Resistance to a pressure blast	4.4	X	X	Once a year
Resistance to high temperatures	4.5	X	X	Once a year
Marking	5.1	X	X	Once a year
Instructions	5.2	X	X	Once a year

8 List of referenced documents

8.1 Standards / normative documents

All normative references in this Approval Requirement refer to the editions of the standards as mentioned in the list below.

EN 437: 2003+A1: 2009	Test gases- test pressure – appliance categories
EN 751-2: 1996	Sealing materials for metallic threaded joints in contact with 1 st , 2 nd and 3 rd family gases and hot water -part 2: non-hardening jointing compounds
EN 10226-1: 2004	Pipe threads where pressure tight joints are male on the treads – Part 1 taper external threads and parallel internal threads.
NEN 1078: 2018	Supply for gas with an operating pressure up to and including 500 mbar - Performance requirements - New estate